



Approval body for construction products and types of construction

#### **Bautechnisches Prüfamt**

An institution established by the Federal and Laender Governments



## European Technical Assessment

## ETA-09/0342 of 1 March 2018

English translation prepared by DIBt - Original version in German language

#### **General Part**

Technical Assessment Body issuing the European Technical Assessment:

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Highload Anchor SLZ

Torque controlled expansion anchor made of galvanised steel of size 14/M10 for use in concrete

MKT Metall-Kunststoff-Technik GmbH & Co. KG Auf dem Immel 2 67685 Weilerbach DEUTSCHLAND

Werk 1,D

12 pages including 3 annexes which form an integral part of this assessment

EAD 330232-00-0601



## **European Technical Assessment** ETA-09/0342

Page 2 of 12 | 1 March 2018

English translation prepared by DIBt

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.



Page 3 of 12 | 1 March 2018

#### European Technical Assessment ETA-09/0342 English translation prepared by DIBt

#### Specific Part

#### 1 Technical description of the product

The Highload Anchor SLZ an anchor made of galvanized steel which is placed into a drilled hole and anchored by torque controlled expansion.

The product description is given in Annex A.

# 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

#### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance under static and quasi-sta loading, displacements	tic See Annex C1 to C2

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C3

# 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 330232-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1



## European Technical Assessment ETA-09/0342

Page 4 of 12 | 1 March 2018

English translation prepared by DIBt


# 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 1 March 2018 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow Head of Department *beglaubigt:* Lange




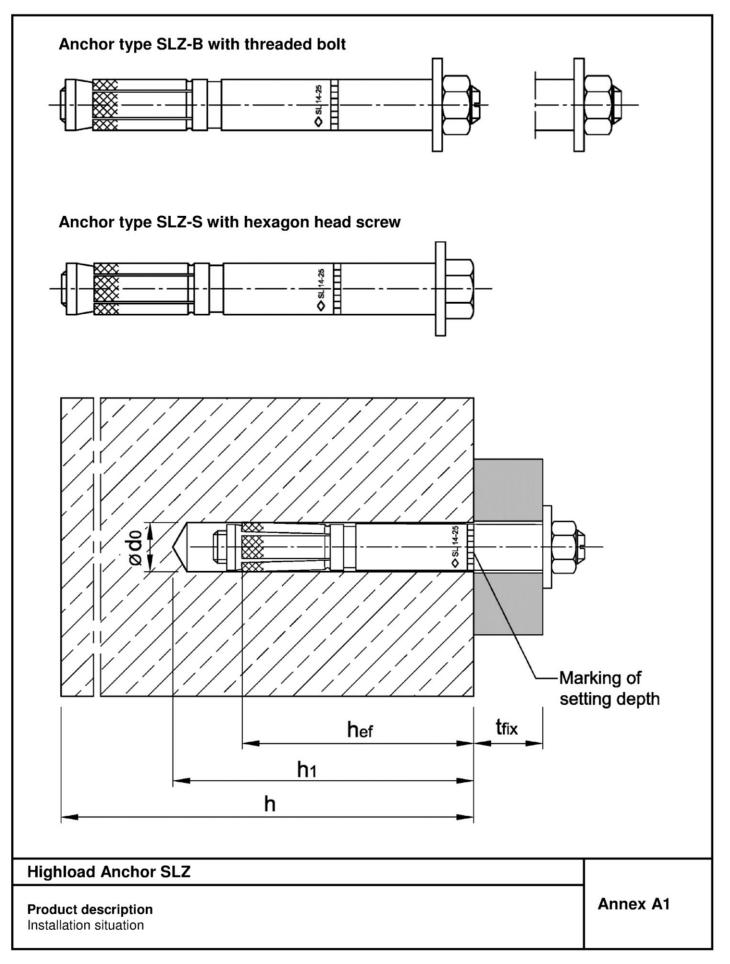

## Page 6 of European Technical Assessment ETA-09/0342 of 1 March 2018

English translation prepared by DIBt



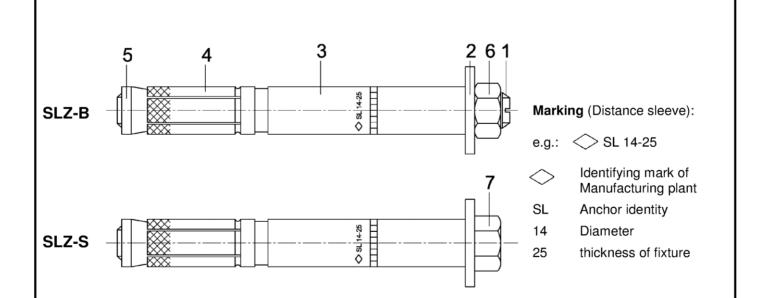

## Table A1: Designation of anchor parts and materials

Part	Designation	Materials galvanised $\geq$ 5 $\mu m,$ acc. to EN ISO 4042:1999		
1	Threaded bolt	Steel, Strength class 8.8, EN ISO 898-1:2013		
2	Washer	Steel, EN 10139:2016		
3	Distance sleeve	Steel tube EN 10305-2:2016; EN 10305-3:2016;		
4	Expansion sleeve	Steel tube EN 10305-2:2016; EN 10305-3:2016;		
5	Threaded cone	Steel, EN 10083-2:2006, plastic coated		
6	Hexagon nut	Steel, Strength class 8, EN ISO 898-2:2012		
7	Hexagon head screw	Steel, Strength class 8.8, EN ISO 898-1:2013		

## Highload Anchor SLZ

**Product description** Anchor dimensions, marking and materials Annex A2



#### Specifications of intended use

#### Anchorages subject to:

- Static or quasi-static action
- fire exposure

#### **Base materials:**

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000
- Strength classes C20/25 to C50/60 according to EN 206-1:2000
- Cracked and uncracked concrete

#### Use conditions (Environmental conditions):

• Structures subject to dry internal conditions (zinc plated steel).

#### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed according to FprEN 1992-4: 2016 and TR 055.

#### Installation:

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- · Positioning of the drill holes without damaging the reinforcement
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.
- Anchor installation such that the effective anchorage depth is complied with. This compliance is ensured, when the embedment mark of the anchor does no more exceed the concrete surface
- Drilling by hammer drill bit (use of vacuum drill bit is admissible)

#### Highload Anchor SLZ


Intended use Specifications Annex B1



Installation instructions	
1 Drill hole perpendicular to con Using a vacuum drill bit, proc	ncrete surface. eed with step 3.
2 Blow out dust. Alternatively v to the bottom of the hole.	acuum clean down
3 Drive in anchor.	
4 <b>T<sub>INST</sub></b> Apply tightening torque T <sub>inst</sub> b wrench.	by using torque
Highload Anchor SLZ	
Installation instructions	Annex B2

#### Deutsches Institut für Bautechnik

Table B1: Installation parameters			
Anchor size			14/M10
Size of thread			M10
Effective anchorage depth	h <sub>ef</sub>	[mm]	65
Nominal diameter of drill bit	do	[mm]	14
Cutting diameter of drill bit	$d_{cut} \leq$	[mm]	14,5
Depth of drill hole	$h_1 \geq$	[mm]	85
Diameter of clearance hole in the fixture mounted on distance sleeve	$d_{\rm f} \leq$	[mm]	16
Diameter of clearance hole in the fixture mounted on threaded bolt	$d_{\rm f} \leq$	[mm]	12
Installation torque	T <sub>inst</sub>	[Nm]	50
Minimum thickness of member	h <sub>min</sub>	[mm]	130
Minimum encoing	S <sub>min</sub>	[mm]	60
Minimum spacing	c≥	[mm]	120
	C <sub>min</sub>	[mm]	70
Minimum edge distance	s≥	[mm]	130

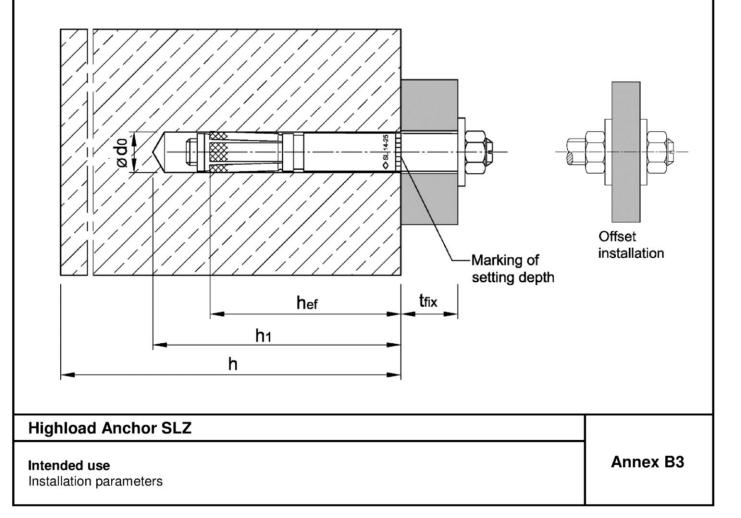



Anchor size			14/M10
Installation safety factor	$\gamma_{inst}$	[-]	1,0
Steel failure			-
Characteristic resistance	N <sub>Rk,s</sub>	[kN]	46
Partial safety factor	γMs	[-]	1,5
Pull-out failure			
Characteristic resistance in cracked concrete C20/25	N <sub>Rk,p</sub>	[kN]	12
Characteristic resistance in uncracked concrete C20/25	N <sub>Rk,p</sub>	[kN]	20
Increasing factors for $N_{\mbox{\scriptsize RK},\mbox{\scriptsize p}}$	Ψc	[-]	$\left(\frac{f_{ck}}{20}\right)^{0,5}$
Concrete cone failure			-
Effective Anchorage depth	h <sub>ef</sub>	[mm]	65
Spacing	S <sub>cr,N</sub>	[mm]	3 h <sub>ef</sub>
Edge distance	$C_{cr,N}$	[mm]	1,5 h <sub>ef</sub>
Factor k1 for cracked concrete	k <sub>cr,N</sub>	[-]	7,7
Factor $k_1$ for uncracked concrete	$k_{ucr,N}$	[-]	11,0
Splitting failure			_
Characteristic resistance in uncracked concrete	${\sf N}^0_{\sf Rk,sp}$	[kN]	min [N <sub>Rk,p</sub> ;N <sup>0</sup> <sub>Rk,c</sub>
Spacing	S <sub>cr,sp</sub>	[mm]	390
Edge distance	C <sub>cr,sp</sub>	[mm]	195

## Table C1: Characteristic values for tension loads

## Table C2: Displacements under tension loads

Anchor size			14/M10
Tension load in cracked concrete	Ν	[kN]	5,7
Displacement	$\delta_{N0}$	[mm]	0,8
	δ <sub>N∞</sub>	[mm]	1,5
Tension load in uncracked concrete	Ν	[kN]	9,5
Displacement	$\delta_{N0}$	[mm]	0,3
	δ <sub>N∞</sub>	[mm]	1,2

## **Highload Anchor SLZ**

#### Performance

Characteristic values and displacements under tension load

Annex C1



Table C5. Characteristic values for silea	liouuo		
Anchor size			14/M10
Steel failure without lever arm			
Characteristic resistance, fixture mounted on distance sleeve with $t_{fix} \le 75 \text{ mm}$	$V^0{}_{Rk,s}$	[kN]	32,8
Characteristic resistance, fixture mounted on distance sleeve with $t_{fix} > 75$ mm	$V^0{}_{Rk,s}$	[kN]	23,2
Factor	k <sub>7</sub>	[-]	1,0
Partial safety factor	γMs	[-]	1,25
Steel failure with lever arm			
Characteristic resistance	$M^0_{Rk,s}$	[Nm]	60
Partial safety factor	γMs	[-]	1,25
Concrete pry-out failure		•	-
Factor	k <sub>8</sub>	[-]	2,0
Concrete edge failure			
Effective length of anchor in shear loading	<sub>f</sub>	[mm]	65
Outside diameter of anchor	d <sub>nom</sub>	[mm]	14

### Table C3: Characteristic values for shear loads

## Table C4: Displacements under shear loads

Anchor size			14/M10
Shear load in non-cracked concrete	V	[kN]	13,2
Dianlagement	$\delta_{V0}$	[mm]	2,2
Displacement	$\delta_{V^\infty}$	[mm]	3,3

## Highload Anchor SLZ

Annex C2



#### Table C5: Characteristic values under fire exposure in concrete C20/25 to C50/60 Anchor size 14/M10 **Tension load** Steel failure R30 0,9 R60 0,8 Characteristic resistance [kN] N<sub>Rk,s,fi</sub> R90 0,6 R120 0,5 Shear load Steel failure without lever arm R30 0,9 R60 0,8 Characteristic resistance $V_{\mathsf{Rk},s,\mathsf{fi}}$ [kN] R90 0,6 R120 0,5 Steel failure with lever arm R30 1,1 R60 1,0 $M^0{}_{\mathsf{Rk},s,\mathsf{fi}}$ Characteristic resistance [Nm] R90 0,7 R120 0,6

## Highload Anchor SLZ

Performance Characteristic values under fire exposure Annex C3